



AMI CONFERENCES  
Bringing the plastics industry together

**Flat roof shatter damage in Germany in spring 2012  
refurbishing the damage; requirements for the future**  
Wolfgang Ernst, President Europäische Vereinigung dauerhaft dichtes Dach e.V.  
2/13

waterproof  
membranes  
2014

# Europäische Vereinigung dauerhaft dichtes Dach

## European Association Durable Dense Roof




First a few words about our association:

The purpose of the organization is the promotion of consumer counseling and consumer protection at home and abroad about all aspects of a permanently tight roof. The association pursues exclusively and directly non-profit purposes and is (industry-) independent.

The purpose of the statutes is especially achieved through:

- preparation, promotion and publication of user-friendly and consumer-friendly images, specifications, inspection and test results of all materials and performances required for a permanently tight roof/part of a building.
- manufacturer-independent user-friendly and consumer-friendly consulting.
- Cooperation with other organisations and individuals at home and abroad which are close to these objectives of the association.

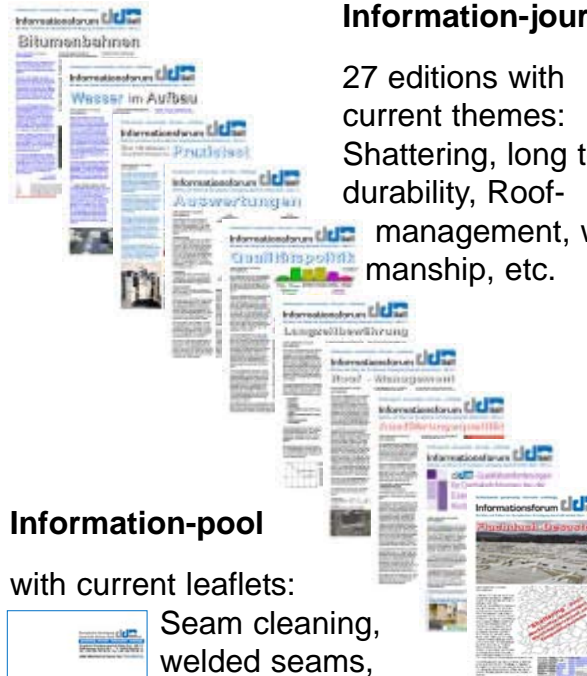


### Information-journal

27 editions with current themes: Shattering, long term durability, Roof-management, workmanship, etc.

### Information-pool

with current leaflets:

Seam cleaning, welded seams, organisation faults, current jurisdiction etc..

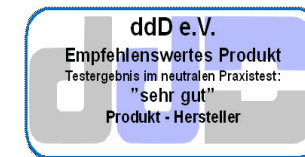


**Recommended requirements**  
for all roofing an sealing sheets

Recommended requirements for all roofing and sealing sheets by dD e.V. (2011)			
Requirement	Minimum	Recommended	Maximum
A. LIFE EXPECTANCY PERIOD	10 years	20 years	30 years
B. RESISTANCE TO WATER	0.5 mm	1.5 mm	2.0 mm
C. TENSILE STRENGTH	10 N/50 mm	15 N/50 mm	20 N/50 mm
D. ACTUAL OF COUPLING	10 N/50 mm	15 N/50 mm	20 N/50 mm
E. IMPERMEABILITY AND PLASTICITY	0.5 mm	1.5 mm	2.0 mm
F. THERMAL STABILITY	-20 °C	0 °C	70 °C
G. RESISTANCE TO PUNCTURE	10 N	15 N	20 N
H. RESISTANCE TO TEAR	10 N	15 N	20 N
I. RESISTANCE TO UV RADIATION	10 years	20 years	30 years
J. RESISTANCE TO SOOT PENETRATION	0.5 mm	1.5 mm	2.0 mm
K. RESISTANCE TO ROOT PENETRATION	0.5 mm	1.5 mm	2.0 mm
L. RESISTANCE TO BIRD PENETRATION	0.5 mm	1.5 mm	2.0 mm
M. RESISTANCE TO ICE PENETRATION	0.5 mm	1.5 mm	2.0 mm
N. RESISTANCE TO WIND UPLIFT	0.5 mm	1.5 mm	2.0 mm
O. RESISTANCE TO FIRE	0.5 mm	1.5 mm	2.0 mm
P. RESISTANCE TO ACID	0.5 mm	1.5 mm	2.0 mm
Q. RESISTANCE TO ALKALI	0.5 mm	1.5 mm	2.0 mm
R. RESISTANCE TO OIL	0.5 mm	1.5 mm	2.0 mm
S. RESISTANCE TO GREASE	0.5 mm	1.5 mm	2.0 mm
T. RESISTANCE TO SALT	0.5 mm	1.5 mm	2.0 mm
U. RESISTANCE TO SULPHUR	0.5 mm	1.5 mm	2.0 mm
V. RESISTANCE TO AMMONIA	0.5 mm	1.5 mm	2.0 mm
W. RESISTANCE TO URIC ACID	0.5 mm	1.5 mm	2.0 mm
X. RESISTANCE TO LIME	0.5 mm	1.5 mm	2.0 mm
Y. RESISTANCE TO HYDROGEN SULPHIDE	0.5 mm	1.5 mm	2.0 mm
Z. RESISTANCE TO CARBON DIOXIDE	0.5 mm	1.5 mm	2.0 mm

**Quality label** for good an excellent products.

**Research Report:** More than 100 roof membranes in comparativ quality test with valuations.



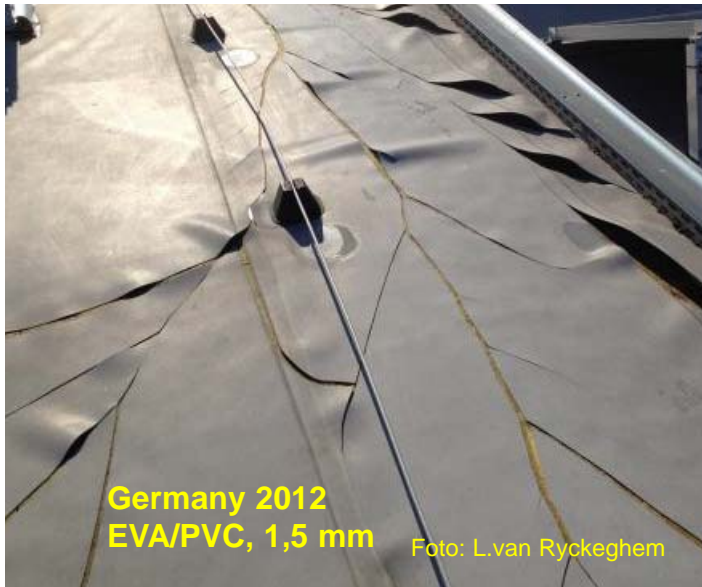

Germany 2012  
EVA/PVC, 1,5 mm

Foto: L.van Ryckeghem

## 2. A review of the 80s

Damage is known from America since the beginning of the 80s to loosely laid, unreinforced PVC roof sheeting. Numerous damages to buildings of the US Army resulted in a 10-year field study by the USA-CERL (US Army - Construction Engineering Research Laboratory), as well as the publication of researches by scientists, associations, engineers and institutes between 1985 and 1995. The evaluation of the studies led to the assumption that sheeting with insert is less vulnerable. Furthermore, the technical reports dealt with the loss in plasticizer, among others, as cause of damage.


The cases of damage in the USA created a lively discussion about the material standardization. It was demanded that the ASTM D4434 - Standard Specification for Polyvinyl chloride (PVC) Sheet Roofing shall be construed stricter in order that it is possible to distinguish between sheeting with long and limited life span.

Only sheeting with insert/reinforcement was listed in the new ASTM D4434 at the beginning of the 90s which had positive effects on the market situation. An increase of the sheeting thickness could also be noted (PAROLI, 1993).

According to documents of our Association (ddDach e.V.), most damage did occur to sheeting made of EVA/PVC in spring 2012. Therefore, the following statements refer to the sheeting with the designation:




Avoiding cold weather roofing failures,  
DREGGER/KNATTERUD, Professional Roofing, November 1989

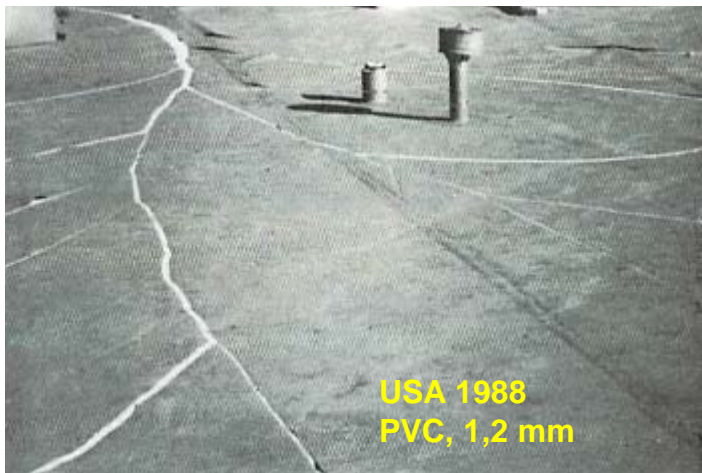

USA 1988  
PVC, 1,2 mm

Samples of materials taken of damaged roof areas as well as available retention samples were tested in the laboratory.

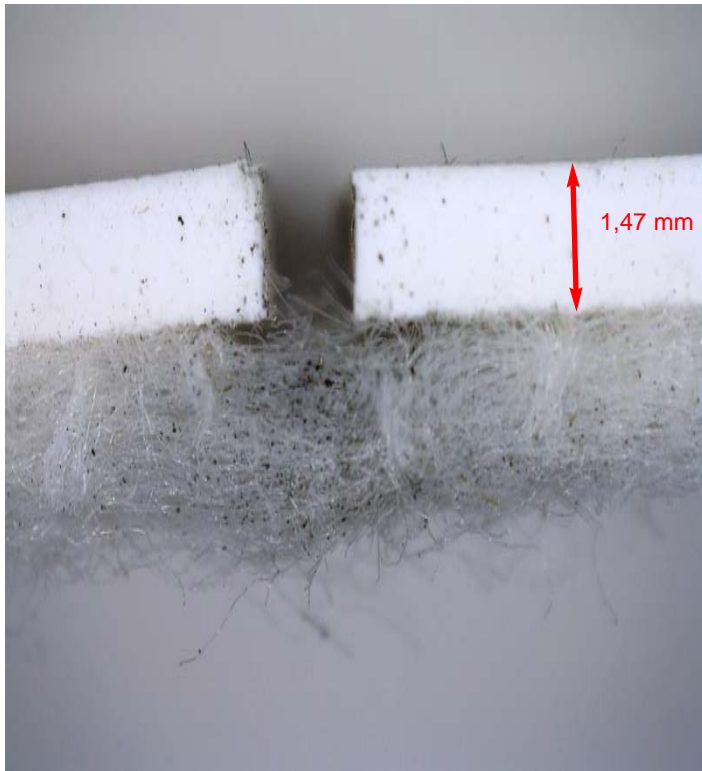

Crack in a unreinforced EVA/PVC-membrane with polyester fleece backing.

## 4. Test results

### 4.1. Changes in property after laboratory stress

- Storage in hot water acc. DIN EN 1847, 50°C, Duration 112 d  
Changing: **27 %**
- Storage in limewash acc. DIN EN 1847, 50°C, Duration 112 d  
Changing: **41 %**
- Storage in acid solution acc. DIN EN 1847, 50°C, Duration 112 d  
Changing: **66 %**
- Hydrolytic resistance, Test acc. ERNST (1999), 90°C, 95 % RF, Duration 7 d,  
Changing: **43 %**

### 4.2. Changes in property after lay time of 2 years

When comparing the retention sample with the damaged sheeting after lay time of 2 years, the following changes in property could be detected:

- Change of the temperature at which damage can occur during resistance to shock-type loads (DIN EN 12 691), drop weight 500 g, drop height 500 mm:  
**from -30 °C to -10 °C**
- Increase of the cool contractile force compared to new material (kp/m) approx. **22 %**
- Significant increase of the modulus (E) MPa (embrittlement) compared to new material by approx. **50 %**  
(Test result ERNST,2008: > 200 kg/m)



	Value	reference sample 2010 (new material)	damaged roof sheet after 2 years	changing in %
<b>EVA</b>	weight%	<b>31</b>	<b>24,5</b>	<b>- 21</b>
<b>PVC</b>	weight%	<b>47,5</b>	<b>47,3</b>	<b>-</b>
<b>additives</b>	weight%	<b>21,5</b>	<b>28,2</b>	<b>+ 24</b>
Total		100	100	

#### 4.4. Material changes after lay time of 2 years until damage occurred


The (enormous) decrease of EVA and increase of additives can be presented and construed as follows:

The material change can be attributed to the hydrolysis susceptibility of the material EVA and the material changes under load to water, lime milk and acid solution of the sheeting respectively - there are clear indications from the test results presented above - Changes in property by standard load in the laboratory.

Table 2: Comparison between reference sample and damaged sheet after 2 years.



IR-Spectre measurement on surface of the reference sample and on surface of the damaged sheet.

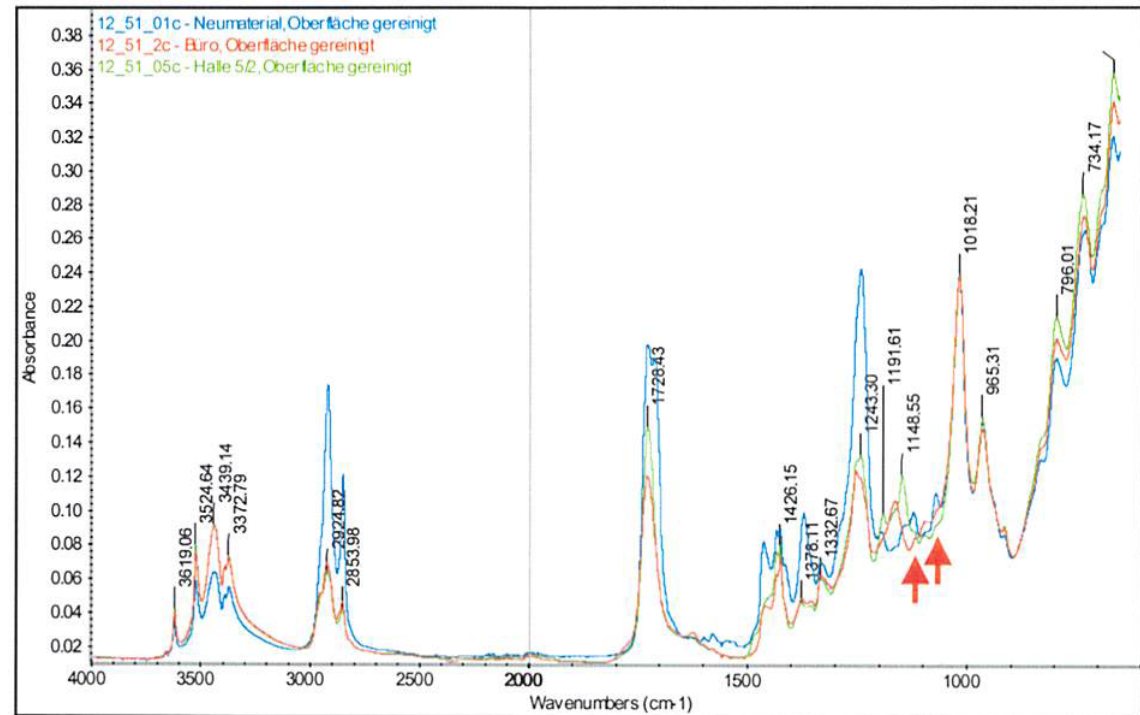



## 6. Forecasts

If one considers all test results of the previous years which are available in the laboratory of the signatory regarding the roof sheeting with the designation "DE/E1 EVA-BV-KPV-1.5" from different years of production and comparable objects, forecasts of the expected life span of the sheeting with natural aging behaviour can be presented in a simplified form (linear). The difference of the forecast of sheeting with an older (14 - 18 years) and younger (6 - 8 years) date of production becomes clearly noticeable in this illustration.

The available test results are directly put in relation to 37 % of the reference value of new material. This reference value is defined as physical limit relevant literature at which the product benefit becomes questionable, e.g. the life span of the product is reached and renovation is necessary.

In addition, occurrences of damage are presented according to lay time and test results on the actual changes in property resulting in the occurrence of damage. The presentation is completed by the material guarantee period and the clearly reduced durability.


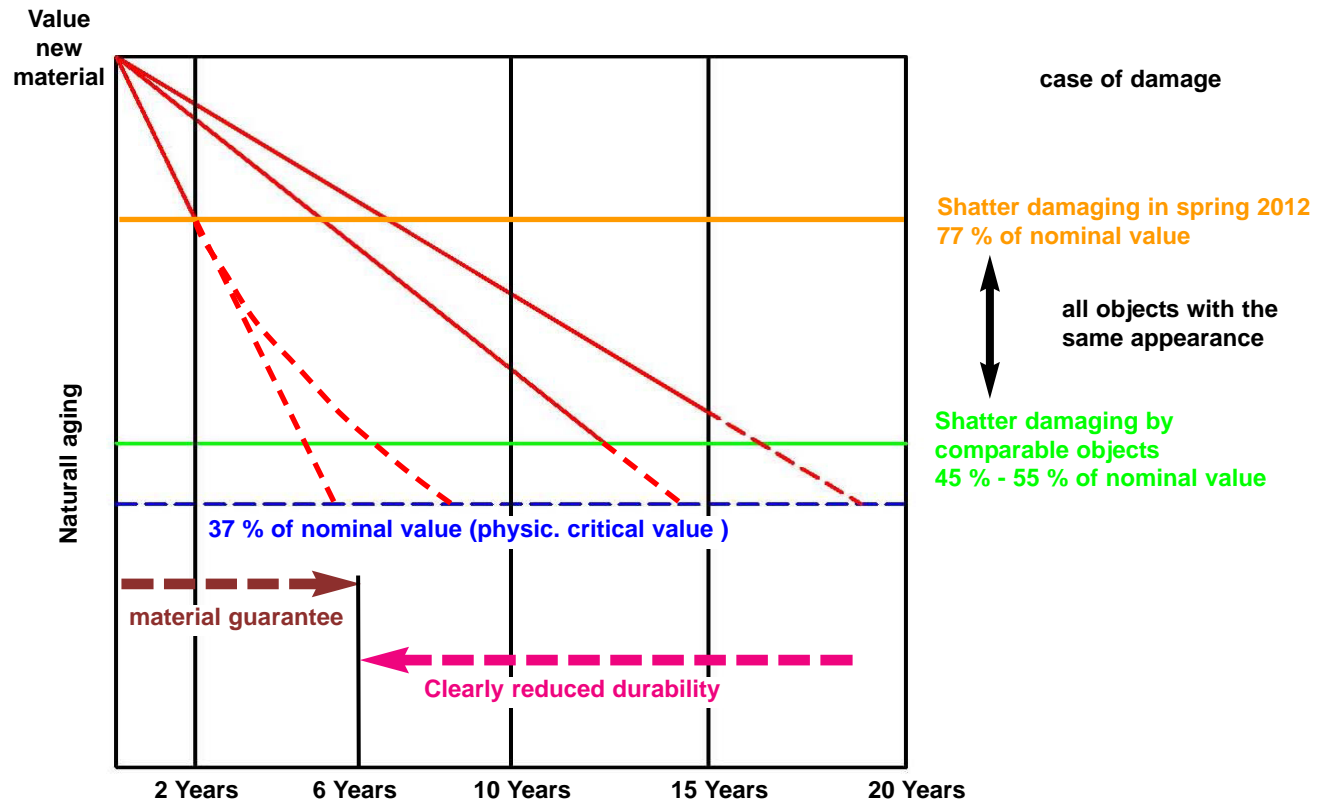


Illustration 1:  
Simple diagram for lifetime with **abstract forecast**.  
Clearly reduced durability between sheets from production-year 1998 to 2010.


Users who appreciate reliable roofs should welcome tests more positively which contribute to the improvement of the information situation and provide a greater market transparency. Tests by ERNST (2009) supplement our picture of the behaviour of roof sealing under side/installation conditions and of the long-term behaviour by practical tests. They also reflect the partly extreme variations in properties within a product category and thus demonstrate that a reasoned decision for a certain product can only be made on the basis of reasonable requirement profiles" (PROF. OSWALD, 2009).

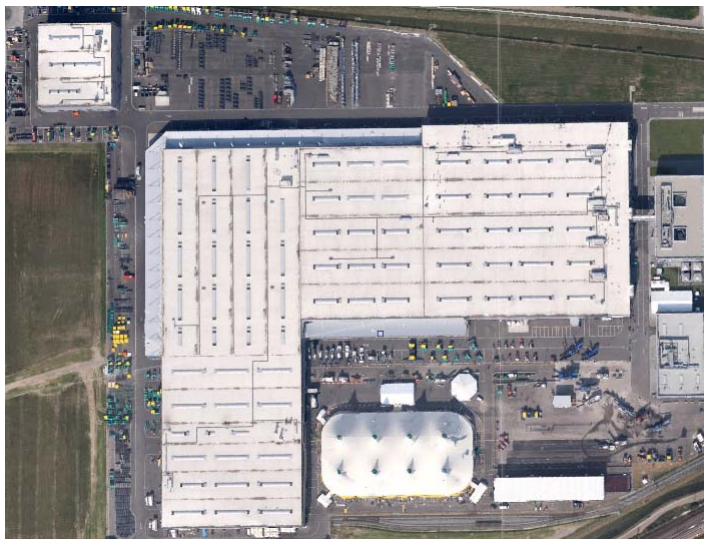

### Recommended requirements for all roofing and sealing sheets by dddDach® (2005)

Roofing and sealing sheet: Materialgroup: _____, Thickness: ≥ _____ mm, with following material properties:	required minimum value	Value of the sheet	perform yes/no
<b>A. LOW TEMPERATURE FOLDING</b> acc. to EN 495-5 Requirements: no rupturing or cracking at	- 30°C		
<b>B. RESISTANCE TO IMPACT</b> acc. to EN 12 691 Requirements: impenetrable, drop mass, weight: 500 g, method A = hard metall support. Height of fall:	≥ 700 mm		
<b>C. HAIL RESISTANCE</b> acc. to EN 13 583 Requirements: damaging velocity - hard/soft support	> 25 m/s		
<b>D. ACTION OF CIGARETTE HEAT</b> acc. to EN 1399 Requirements:	impenetrable		
<b>E. STRAIGHTNESS AND FLATNESS</b> acc. to EN 1848-2 Requirements: deviation of straightness(g) deviation of flatness (p)	< 30 mm < 10 mm		
<b>F. HOT AIR WELDING</b> Welding window according to ERNST 1999 (attached):	yes/no		
<b>G. BEHAVIOUR AFTER COATING WITH GREASE</b> acc. to ERNST (1992) Requirements: absolute elongation* acc. to EN 12311-2 change elongation compared to new material	≥ 200 % ≤ 25 % relative*		
<b>H. BEHAVIOUR AFTER STORAGE IN HOT WATER</b> acc. to EN 1847 Hot water temperature: 50°C, Duration: 16 weeks, Requirements: absolute elongation* acc. to EN 12311-2 change elongation compared to new material	≥ 200 % ≤ 25 % relative*		
<b>I. BEHAVIOUR AFTER STORAGE IN LIMEWASH</b> acc. to EN 1847 Hot water temperature: 50°C, Duration: 16 weeks, Requirements: absolute elongation* acc. to EN 12311-2 change of elongation compared to new material	≥ 200 % ≤ 25 % relative*		
<b>J. BEHAVIOUR AFTER STORAGE IN AN ACID SOLUTION</b> acc. to EN 1847, Hot water temperature: 50°C, Duration: 16 weeks, Requirements: absolute elongation* acc. to EN 12311-2 change elongation compared to new material	≥ 200 % ≤ 25 % relative*		
<b>K. RESITANCE AGAINST MICROORGANISMS</b> acc. to EN-ISO 846, pretreatment before biological test: acc. to EN 1847: Hot water: 50°C, time 14 days, soil-burial test: time 32 weeks, Requirements: Weight loss in contrast to new material	≤ 4 %		
<b>L. HYDROLYTIC RESISTANCE</b> acc. to ERNST (1992) Requirements: change elongation to new material Weight loss compared to new material	≤ 25 % relative* < 3 %		
<b>M. OZONE RESISTANCE</b> acc. to EN 1844 Requirements: no cracks at 6 x magnification	no cracking		
<b>N. LONG THERM ARTIFICIAL AGEING</b> acc. to EN 1296, time 24 weeks, 70°C, Requirements: change of mass compared to new material change elongation to new material	≤ 5 % ≤ 25 % relative*		
<b>O. ARTIFICIAL AGEING BY L. TH. EXPOSURE TO UV RADIATION</b> acc. to EN 1297 Requirements: - unballasted membranes 5.000 h - ballasted membranes 3.000 change of mass: ballasted and unballasted membranes	Scale 0 Scale 0 ≤ 3 %		
<b>P. FISHTEST</b> acc. to OECD »Fish Acute Toxicity Test«, Procedure 203, EEC directive 92/69EEC, DIN 38 412 L 31, Description: ERNST(1999), Testfish: Poecilia reticulata (Guppy), Requirements:	> 24 h		
<b>Q. COLD CONTRACTION</b> acc. to ERNST (1999), Requirements:	< 200 kg/m		
<b>R. RESISTANCE TO ROOT PENETRATION</b> acc. to FLL-Test (1999): Requirements: resistance against root and rhizome penetration (attached):	yes/no		
<b>S. DECLARATION ECOLOGICAL CHARACTERISTICS</b> acc. to SIA 493 (att.):	yes/no		
elongation* absolute for unreinforced and bonded sheets and membranes with glass mesh reinforcement.			
In signing this document, the manufacturer confirms that the values given above can be verified by an officially recognized, public test laboratory or a testing institution in keeping with the international standards of quality management and quality systems (ISO 9001).			
Manu- facturer	The specified values apply to the product trade name/material:		Company stamp and sign:
	Product/Article: _____ / _____		
	CE-mark according attached technical data sheet		

### Result of the comparativ quality test of more than 100 membranes

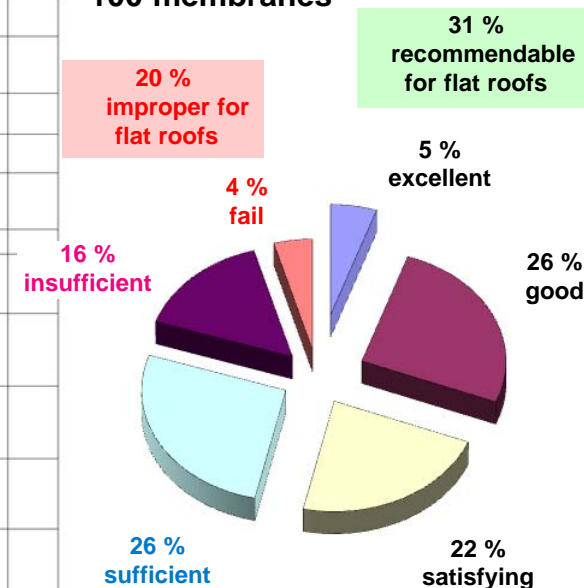



Examples of two improper unreinforced membranes from the past



## Europäische Vereinigung dauerhaft dichtes Dach e.V.

### 8. Future damage prevention

Considering the present test results, a controversial discussion is no longer needed. The facts are known. The weather conditions of the winter 2011/2012 can occur again at any time. Thus, there are the following references, recommendations and demands respectively by our association - ddDach e.V.:

- **Unreinforced PVC sheeting and homogenous sheeting with PVC content respectively do no longer belong on the freely exposed roof.**
- **All persons involved in the construction: principal, client, planner and worker take an incalculable risk with the decision for unreinforced PVC sheeting and sheeting with PVC content respectively.**
- **Planners who still tender this sheeting and workers who still lay this sheeting respectively are acting (grossly) negligent.**
- **The effective thickness of reinforced plastic sheeting should not be below 1.8 mm.**
- **The selection of sheeting should be made according to practical test criteria. They have already been published in 2006 (recommended requirements) by our association.**

Europäischer Vereinigung dauerhaft dichtes Dach e.V.  
**for Building Better Flat Roofs**